



Testing. Advising. Assuring.

Test report No. 2018-1764

for applying of a required "Verwendbarkeitsnachweis"
issued 02.10.2018

Applicant: AB Ludvig Svensson
Bangatan 8

SE-511 82 Kinna

Date of order: 13.09.2018
Date of sampling: *no official sampling of the specimen by a representative of Exova Warringtonfire, Frankfurt*
Date of arrival: 14.09.2018
Date of test: 01.10.2018

Order

Testing of the flammability (building class B1) according to DIN 4102-1 (May 1998)

Description / designation of the test object

Product name: Marble

Description of the relevant test procedure

DIN 4102 part 1 (Mai 1998)

This test report does not replace the required „Verwendbarkeitsnachweis“. It is only used for issuing the "Verwendbarkeitsnachweis".



1. Description of the test material

1.1 Details of the customer:

Product name: Marble

Product description:

Name: Marble

Product: Curtain

Colour: Blue

Weight: 230 g/m²

Composition: 100% Flame retardant polyester

Intended end use of product: Curtain

1.2 By Exova Warringtonfire, Frankfurt determined values:

fabric sample

Colour: green

Thickness: 0,39 mm

Square weight: 229 g/m²

Testing after storing 14- days under climatic conditions (23°C / 50 % rel. humidity).

2. Test results

2.1.1 Brandschachtprüfung according to DIN 4102-1

Sample A: Material tested in production direction.
Sample B: Material tested cross to the production direction.

Test results of the Brandschacht tests part 1						
line no.		Measurements test sample				
			A	B	C	D
1	<u>no. test arrangement according to DIN 4102 part 15, table 1</u>		1	2		
2	<u>flame height max. over lower sample edge</u> time ¹⁾	cm	30	30		
		min : s	00:10	00:11		
3	<u>ascertainments on the front side</u> Flaming/glowing time ¹⁾	min : s	00:04	00:03		
4	<u>melting / burning through</u> time ¹⁾	min : s	00:06	00:05		
5	<u>ascertainments on the back side</u> Flaming/glowing time ¹⁾ discolouring time ¹⁾	min : s	no	no		
6		min : s	no	no		
7	<u>burning droplets</u> begin ¹⁾ extent occasional dropping of material constant dropping of material	min : s	no	no		
8						
9						
10	<u>separating from burning sample parts</u> begin ¹⁾ occasional separating parts constant separating parts	min : s	no	no		
11						
12						
13	<u>duration of burning on the sieve tray (max.)</u>	min : s	no	no		
14	<u>influence on the burner flame by dropping of / separating material</u> time ¹⁾		no	no		
		min : s				
15	<u>earlier end of test</u> end of the fire scenario on the sample ¹⁾	min : s	no	no		
16	<u>time of a possible resulted test stop</u> ¹⁾	min : s				

¹⁾ time from start of test

Test results of the Brandschacht tests part 2						
line no.		Measurements test sample				
			A	B		
17	<u>flaming after end of test</u>	min : s	no	no		
18	duration		no	no		
19	number of sample		no	no		
20	front side of sample		no	no		
21	backside of sample	cm	no	no		
21	flame length		no	no		
22	<u>glowing after end of test</u>	min . s	--/--	--/--		
22	duration		no	no		
23	number of sample		no	no		
23	place of occurrence		no	no		
24	lower sample part		no	no		
25	upper sample part		no	no		
26	front side of sample		no	no		
27	backside of sample		no	no		
28	<u>smoke density</u>					
28	< 400 % x min		0	0		
29	> 440 % x min		--/--	--/--		
30	diagram in annex no.		1	2		
31	<u>residual length</u>	cm				
31	single results		67 / 71	68 / 68		
32	average of the single results		69 / 68	69 / 68		
33	photo of the sample on page		68	68		
34	<u>smoke temperature</u>	°C				
34	max. of the average results		114	117		
35	time ¹⁾		09:56	09:31		
36	diagram in annex no.		1	2		

¹⁾ time from start of test

Remarks: As the residual length was > 45 cm in the length and cross direction of the Brandschacht test, no further tests were necessary according to DIN 4102-16.

2.1.3 Appearance of the specimen after the test:

Sample A



Sample B



2.2.1 Normal flammability test according to DIN 4102-1

Test with edge ignition without deposit
Flame application on: lower sample edge
Edge ignition

length direction:

Sample-no.	1	2	3	4	5
Time from start of test					
Ignition point [s]	1	1	1	1	1
Reaching the measuring mark within 20 seconds	no	no	no	no	no
Self-extinguishing of the flame [s]	3	3	3	3	3
Max. flame height [mm]	30	30	30	30	30
Time [s]	3	3	3	3	3
End of afterflaming [s]	-	-	-	-	-
End of afterglowing [s]	-	-	-	-	-
Flames extinguished after [s]	-	-	-	-	-
Smoke development (visual impression) _{low / moderate / strong}	low smoke development				
Separating from burning material	no	no	no	no	no
Time [s]	-	-	-	-	-

Remarks: none

cross direction:

Sample-no.	1	2	3	4	5
Time from start of test					
Ignition point [s]	1	1	1	1	1
Reaching the measuring mark within 20 seconds	no	no	no	no	no
Self-extinguishing of the flame [s]	3	4	4	4	3
Max. flame height [mm]	30	30	30	30	30
Time [s]	3	3	3	3	3
End of afterflaming [s]	-	-	-	-	-
End of afterglowing [s]	-	-	-	-	-
Flames extinguished after [s]	-	-	-	-	-
Smoke development (visual impression) _{low / moderate / strong}	low smoke development				
Separating from burning material	no	no	no	no	no
Time [s]	-	-	-	-	-

Remarks: none

2.2.4 Appearance of the sample after the small burner test:



Assessment

The material described in chapter one fulfils the requirements of the building class B2 according to DIN 4102-1 (Mai 1998).

The determined test results show that the material also fulfils the requirements

of the building class B1

according to DIN 4102-1 (Mai 1998).

Special note

The fire test result is only valid for the material described in chapter one in the tested colour, surface weight and thickness.

The test was carried out in free hanging configuration.

The distance to other plane material must be more or equal then 40 mm.

The material wasn't tested after an outside storage.

In combination with other materials (for example coatings, deposits) the burning behaviour could be influenced unfavourable so that the classification above is not valid any longer. According to DIN 4102-1 the burning behaviour in combination with other materials has to be tested separately.

This test report does not replace the required „Verwendbarkeitsnachweis“. It is only used for issuing the “Verwendbarkeitsnachweis”.

Frankfurt, the 02nd October 2018

A handwritten signature in blue ink, appearing to read "Anders".

H. Anders
Tester in Charge

A handwritten signature in blue ink, appearing to read "Scheinkönig".

P. Scheinkönig
Prüfstellenleiter Bau-PVO



This Test report is valid until 30.09.2023.

The results of the tests relate only to the behaviour of the test specimen which is designated on the top.



Test reports are only allowed to be published or reproduced, not changed in form and tenor without permission of the Exova Warringtonfire, Frankfurt. The abridged account of a test report is only allowed with the agreement of the Exova Warringtonfire, Frankfurt.

This test report is a translation of the German version 2018-1764 (issued 02.10.2018). In case of doubt only the German version is valid

This test report contains 8 pages and 2 annexes.

Annex 1 to the Test report No. 2018-1764 issued 02.10.2018

Sample A:

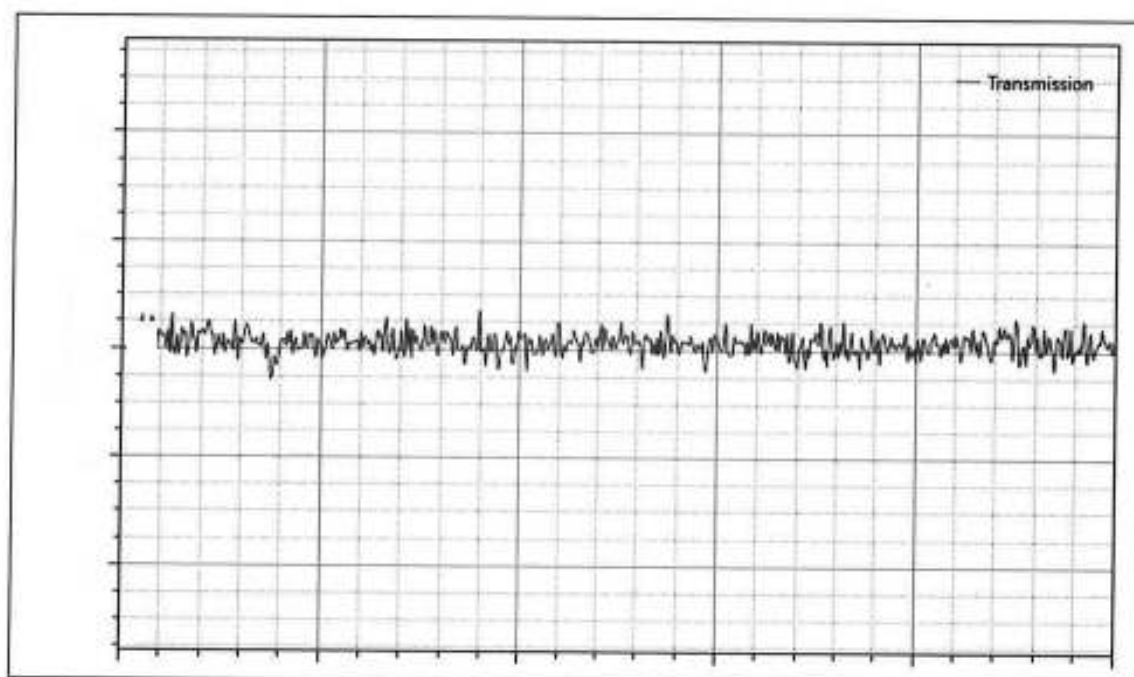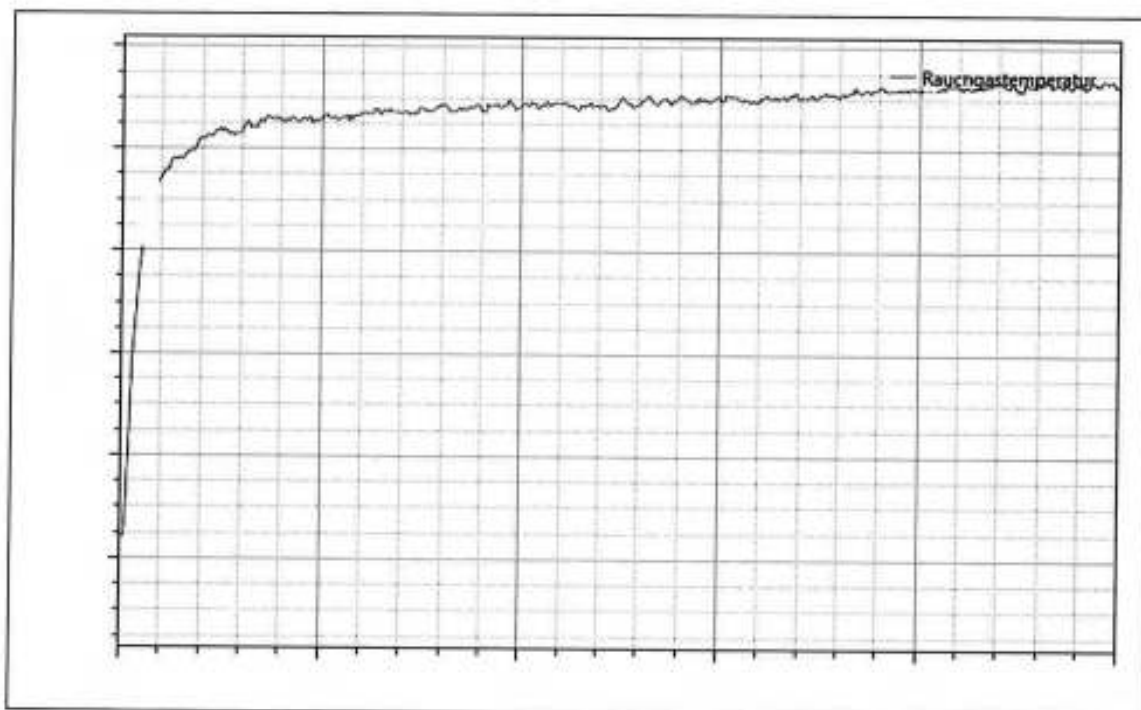

Testing. Advising. Assuring.

Annex 2 to the Test report No. 2018-1764 issued 02.10.2018

Sample B:

